



# Single Wall Round Catalog



[www.ehgduct.com](http://www.ehgduct.com)



# Table of Contents

Nomenclature Definitions.....	4	Conversion Chart: Rectangular to Round .....	7
Smart Part Anatomy .....	5	Specification .....	8
EHG G3 Assembly Instructions .....	6	Tolerance, Gauge, e-dimension & Fittings Slip Dimension.....	9

## Spiral Duct

Corrugated/Non-corrugated - SC/SN .....	10
---	----

## Elbows

90° 1.5" Radius Elbow - E 90 .....	11
90° 1.0" Radius Elbow - ER 90 .....	12
60° 1.0" Radius Elbow - ER 60 .....	13
45° 1.5" Radius Elbow - E 45 .....	14
45° 1.0" Radius Elbow - ER 45 .....	15
30° 1.0" Radius Elbow - ER 30 .....	16
15° 1.0" Radius Elbow - ER 15 .....	17
Mitered Elbow - BM.....	18
Mitered Elbow w/Vanes - BMV .....	18

## Reducers

Concentric Reducers - RC/RCF .....	19
Fabricated Concentric Reducers - RC/RCF .....	20
Fabricated Eccentric Reducers - RE/REF .....	21

## Taps

45° Boot-Style Tap - PBF/PB .....	22
Pressed or Fabricated Saddle Tap - PS .....	23
45° Lateral or Conical Saddle Tap for Round - PV45/PC.....	24
45° Lateral or Conical Saddle Tap for Flat - PVF45/PCF .....	25

## Tees/Crossing Tees

Bullhead Tee - TBH/TRBH .....	26
45° Boot-Style Tee - TB/TRB .....	27
45° Boot-Style Crossing Tee - XB/XRB .....	28
Conical Tee - TC/TRC .....	29
Conical Crossing Tee - XC/XRC .....	30
Assembled Tee - TS/TRS .....	31
Assembled Crossing Tee - XS/XRS .....	32
45° Lateral Tee - TV45/TRV45 .....	33
45° Lateral Crossing Tee - XV45/XRV45 .....	34

## Y-Branch

45° Directional Split Fitting - Y45 .....	35
---	----

## Offsets

One-Piece Offset - Z .....	36
----------------------------	----

## Couplings

Coupler - CD/CF .....	37
-----------------------	----

## End Caps

End Cap - ED/EF .....	38
-----------------------	----

## Take-Offs

Flat or Bellmouth Take-Off - PT/PR.....	39
---	----


## Dampers

Manual Balancing Damper - DS/DSW .....	40
Gasketed Flat or Bellmouth Damper - DPT/DPR .....	41
Damper with Saddle Tap - DSPTS .....	42
Balancing Damper with Complete Air Shut Off - DT .....	43

## Square to Round

Square to Round Transition - RRT .....	44
--	----

# Nomenclature Definitions

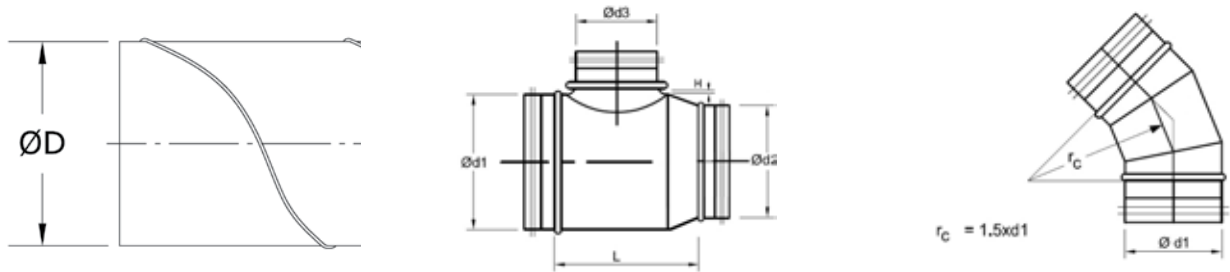

- Nominal inside diameter (duct size).....  $\text{ØD}$
- Nominal outside diameter (fitting size).....  $\text{Ød1}, \text{Ød2}, \text{Ød3}, \text{Ød4}$
- Material thickness (gauge).....  $t$
- Installed height.....  $H$
- Center line radius.....  $r_c$
- Installed length.....  $L$
- Fitting slip dimension .....  $e$
- All measurements in inches (in or ") unless otherwise noted
- All angles in degrees ( $^\circ$ )

# Smart Part Anatomy

## Nomenclature / Abbreviations

PRODUCT	Designation And Description	PRODUCT	Designation And Description
<b>DUCT</b>	SC = Corrugated Single Wall Round Spiral Duct SN - Noncorrugated Single Wall Round Spiral Duct	<b>ELBOWS</b>	E = 1.5 Radius Elbow Stamped Or With 3 - 5 Gores ER = 1.0 Radius Elbow Stamped Or With 3 - 4 Gores
<b>REDUCERS</b>	RC = Reducer Concentric Male RCF = Reducer Concentric Female RE = Reducer Ecentric Male REF = Reducer Ecentric Female	<b>END CAPS</b>	ED = End Duct EF = End Fitting
<b>COUPLINGS</b>	CD = Coupling Duct CF = Coupling Fitting	<b>TAKE-OFFS</b>	PT = Straight Take Off PR = Radius Take Off
<b>TEES</b>	TBH = Bull Head Tee TRBH = Reducing Bull Head Tee TB = Tee With Boot Tap TRB = Reducing Tee With Boot Tap TC = Tee With Conical Tap TRC = Reducing Tee With Conical Tap TS = Straight Tee TRS = Reducing Straight Tee	<b>CROSSING TEES</b>	XB = Boot Style Crossing Tee XRB = Reducing Boot Style Crossing Tee XC = Conical Crossing Tee XRC = Reducing Conical Crossing Tee XS = Crossing Tee XRS = Reducing Crossing Tee XV = Lateral Crossing Tee XRV = Reducing Lateral Crossing Tee
<b>LATERAL TEES</b>	TV = Tee With Lateral Tap TRV = Reducing Tee With Lateral Tap	<b>Y-BRANCH</b>	Y = Y Branch
<b>TAPS</b>	PB = Boot Tap PBF = Boot Tap Flat PS = Press Tap PV = Lateral Tap PVF = Lateral Tap Flat PC = Conical Tap PCF = Conical Tap Flat	<b>DAMPERS</b>	DS = Damper DT = Damper DSIL = Combination Damper with Take-Off DSILR = Combination Damper with Take-Off DSPS = Combination Damper with Saddle Tap

### REQUIRED FOR ORDERING

### OPTIONAL FOR ORDERING SMACNA STANDARDS PROVIDED IF NOT GIVEN

CONNECTION	DIAMETER (INCH)	PART DESIGNATION	MATERIAL	THICKNESS
G = G3 N = G0	Diameter	See Chart Above	G9 = G90 Galvanized S4 = S304 Stainless S6 = S316 Stainless GN = Galvanneal / Paint Grip AL = Aluminum	Gauge
<i>Eg = G</i>	<i>Eg = 16</i>	<i>Eg = CD</i>	<i>Eg = G9</i>	<i>Eg = 24</i>



= G3 16" Diameter Coupling Duct In Galvanized 24 Gauge

# EHG G3 Assembly Instructions

## Preparations For Assembly

- Check that all ductwork to be used in the system is EHG G3 and is undamaged. All EHG G3 fittings must be used with calibrated spiral duct certified by EHG.
- Do not use any ductwork that has been damaged in such a way that it may jeopardize the air tightness or structural strength of the system.
- Store all ductwork in a well organized and weather proof storage area to minimize the risk of damage.
- Cut all spiral duct at right angles and carefully remove any burrs from the cut edges. Installation is easier and the risk of damaging the gasket is reduced if there are no burrs.

## Assembly

1. Start by inserting the turned-over edge of the fitting into the spiral duct (figure 1).
2. Check that the first lip of the gasket is in contact with the edge of the spiral duct all the way around and sticks straight out so that the lip is not twisted in one direction or the other.
3. Push the end of the fitting into the spiral duct. Turning the fitting slightly aids insertion. Removal, if necessary, is also aided by turning (figure 2)
4. Secure the fitting in the spiral duct using self-tapping screws or airtight pop rivets. Quantities and sizes to be used are shown in the table below. Do not use more fasteners than specified.
5. Fasteners should be positioned 1/2 inch from the bead stop to prevent damage to the gasket (figure 3).

Spiral Pipe Dia. (in)	Screw Dia. (in)	Quantity
3-5	1/8	2
6-10	1/8	3
12-24	1/8	4
26-50	1/8	6
52-60	1/8	8

6. Placement of the fastening screws should be opposite from one another evenly spaced around the circumference, much like the procedure for tightening lug nuts on a tire. Start where the distance between the spiral duct and the fitting is largest (figure 4).

Carefully seal any holes left by measurements, removed screws, pop rivets, etc.

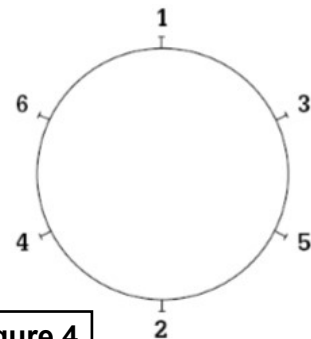
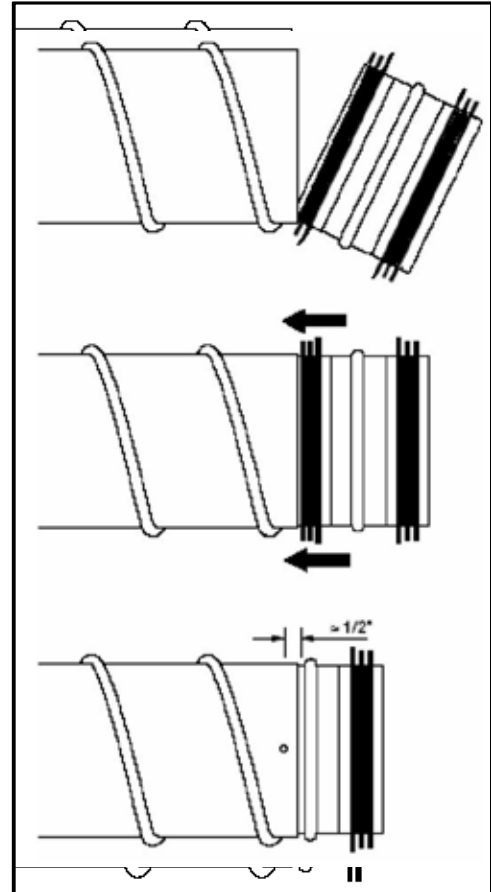


Figure 4

# Rectangular to Round Conversion

b/a	4	6	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
3	3.8	4.6	5.2	5.7	6.2	6.6	7.0	7.3	7.7	8.0	8.3	8.5	8.8	9.0	9.3	9.5	9.7	9.9	10.1
4	4.4	5.3	6.1	6.7	7.3	7.8	8.3	8.7	9.1	9.5	9.8	10.1	10.4	10.7	11.0	11.3	11.5	11.8	12.0
5	4.9	6.0	6.9	7.6	8.3	8.9	9.4	9.9	10.3	10.8	11.2	11.5	11.9	12.2	12.6	12.9	13.2	13.5	13.8
6	5.3	6.6	7.6	8.4	9.1	9.8	10.4	11.0	11.5	12.0	12.4	12.8	13.2	13.6	14.0	14.4	14.7	15.0	15.3
7	5.7	7.1	8.2	9.1	9.9	10.7	11.3	11.9	12.5	13.0	13.5	14.0	14.5	14.9	15.3	15.7	16.1	16.5	16.8
8	6.1	7.6	8.7	9.8	10.7	11.5	12.2	12.9	13.5	14.1	14.6	15.1	15.6	16.1	16.5	17.0	17.4	17.8	18.2
9	6.4	8.0	9.3	10.4	11.3	12.2	13.0	13.7	14.4	15.0	15.6	16.2	16.7	17.2	17.7	18.2	18.6	19.0	19.5
10	6.7	8.4	9.8	10.9	12.0	12.9	13.7	14.5	15.2	15.9	16.5	17.1	17.7	18.3	18.8	19.3	19.8	20.2	20.7
11	7.0	8.8	10.2	11.5	12.6	13.5	14.4	15.3	16.0	16.8	17.4	18.1	18.7	19.3	19.8	20.4	20.9	21.4	21.8
12	7.3	9.1	10.7	12.0	13.1	14.2	15.1	16.0	16.8	17.6	18.3	19.0	19.6	20.2	20.8	21.4	21.9	22.4	22.9
13	7.6	9.5	11.1	12.4	13.7	14.7	15.7	16.7	17.5	18.3	19.1	19.8	20.5	21.1	21.8	22.4	22.9	23.5	24.0
14	7.8	9.8	11.5	12.9	14.2	15.3	16.4	17.3	18.2	19.1	19.9	20.6	21.3	22.0	22.7	23.3	23.9	24.5	25.0
15	8.0	10.1	11.8	13.3	14.6	15.8	16.9	17.9	18.9	19.8	20.6	21.4	22.1	22.9	23.5	24.2	24.8	25.4	26.0
16	8.3	10.4	12.2	13.7	15.1	16.4	17.5	18.5	19.5	20.4	21.3	22.1	22.9	23.7	24.4	25.1	25.7	26.4	27.0
17	8.5	10.7	12.5	14.1	15.6	16.8	18.0	19.1	20.1	21.1	22.0	22.9	23.7	24.4	25.2	25.9	26.6	27.2	27.9
18	8.7	11.0	12.9	14.5	16.0	17.3	18.5	19.7	20.7	21.7	22.7	23.5	24.4	25.2	26.0	26.7	27.4	28.1	28.8
19	8.9	11.2	13.2	14.9	16.4	17.8	19.0	20.2	21.3	22.3	23.3	24.2	25.1	25.9	26.7	27.5	28.2	28.9	29.6
20	9.1	11.5	13.5	15.2	16.8	18.2	19.5	20.7	21.9	22.9	23.9	24.9	25.8	26.6	27.5	28.3	29.0	29.8	30.5
22	9.5	12.0	14.1	15.9	17.6	19.1	20.4	21.7	22.9	24.0	25.1	26.1	27.1	28.0	28.9	29.7	30.5	31.3	32.1
24	9.8	12.4	14.6	16.5	18.3	19.9	21.3	22.7	23.9	25.1	26.2	27.3	28.3	29.3	30.2	31.1	32.0	32.8	33.6
26	10.1	12.8	15.1	17.1	19.0	20.6	22.1	23.5	24.9	26.1	27.3	28.4	29.5	30.5	31.5	32.4	33.3	34.2	35.1
28	10.4	13.2	15.6	17.7	19.6	21.3	22.9	24.4	25.8	27.1	28.3	29.5	30.6	31.7	32.7	33.7	34.6	35.6	36.4
30	10.7	13.6	16.1	18.3	20.2	22.0	23.7	25.2	26.6	28.0	29.3	30.5	31.7	32.8	33.9	34.9	35.9	36.8	37.8
32	11.0	14.0	16.5	18.8	20.8	22.7	24.4	26.0	27.5	28.9	30.2	31.5	32.7	33.9	35.0	36.1	37.1	38.1	39.0
34	11.3	14.4	17.0	19.3	21.4	23.3	25.1	26.7	28.3	29.7	31.1	32.4	33.7	34.9	36.1	37.2	38.2	39.3	40.3
36	11.5	14.7	17.4	19.8	21.9	23.9	25.7	27.4	29.0	30.5	32.0	33.3	34.6	35.9	37.1	38.2	39.4	40.4	41.5
38	11.8	15.0	17.8	20.2	22.4	24.5	26.4	28.1	29.8	31.3	32.8	34.2	35.6	36.8	38.1	39.3	40.4	41.5	42.6
40	12.0	15.3	18.2	20.7	22.9	25.0	27.0	28.8	30.5	32.1	33.6	35.1	36.4	37.8	39.0	40.3	41.5	42.6	43.7
42	12.3	15.6	18.5	21.1	23.4	25.6	27.6	29.4	31.2	32.8	34.4	35.9	37.3	38.7	40.0	41.3	42.5	43.7	44.8
44	12.5	15.9	18.9	21.5	23.9	26.1	28.1	30.0	31.8	33.5	35.1	36.7	38.1	39.5	40.9	42.2	43.5	44.7	45.8
46	12.7	16.2	19.3	21.9	24.4	26.6	28.7	30.6	32.5	34.2	35.9	37.4	38.9	40.4	41.8	43.1	44.4	45.7	46.9

$$D_e = 1.30 [(ab)^{0.625}/(a+b)^{0.250}]$$

- a = length of one side of rectangular duct (inch)
- b = length of adjacent side of rectangular duct (inch)
- D<sub>e</sub> = round equivalent of rectangular duct for equal friction and capacity (inch)

**Example**

Convert rectangular duct 22" x 12" to equivalent round

a = 22, b = 12; from above table

D<sub>e</sub> = 17.6, use 18" diameter

Source: 2017 ASHRAE Fundamentals, p. 21.8





# Specifications

**MATERIAL** ( \* ) not available in pressed construction

- Galvanized steel conforming to ASTM standards A653 and A924
- Stainless steel type 304L conforming to ASTM standard A240\*
- Stainless steel type 316L conforming to ASTM standard A240\*
- Aluminum 3003-H14 conforming to ASTM standard B209\*

## **SURFACE FINISH**

- Galvanized steel (galvanized in accordance with latest SMACNA HVAC Duct Construction Standards).
- Stainless steel type 304L - 2B Mill Finish (#4 finish available upon request)
- Stainless steel type 316L - 2B Mill Finish (#4 finish available upon request)
- ProCoat™ (outside only) or ProCoat™ Plus (inside and outside) on duct and/or fittings
  - Standard color = white (additional color options available)
  - Average coating thickness of 4 mils (0.004 inch)
  - ProCoat™ to meet or exceed 500 hour Salt Spray Test per ASTM B117
  - ProCoat™ Plus to meet or exceed 3,000 hour Salt Spray Test per ASTM B117
- Antimicrobial - EHG AM™ is EPA registered for HVAC applications as a water based microbistatic formula designed for control growth of microorganisms.

## **THICKNESS**

Material thickness constructed from galvanized steel in accordance with the latest SMACNA's HVAC Duct Construction Standards for +10" water gauge pressure. **Consult factory for negative pressure systems.**

## **CONSTRUCTION**

- A. Duct is of spiral lock seam construction with a mechanically formed seam locking indentation evenly spaced along the spiral seam. All spiral duct 8" diameter and larger shall incorporate multiple corrugations between spiral seams.
- B. Fittings shall be manufactured using one or more of the following construction methods:
  - Overlapped edges stitch welded along the entire length of the fitting
  - Standing seam gore locked and internally sealed
  - Button punched and internally sealed
  - Elbows 3" through 12" diameter will be die stamped and continuously stitch welded.

## **CONNECTIONS**

Fitting ends shall be sized to slip-fit into spiral duct of the same nominal size. Fitting to fitting connections shall be made by use of duct size "CF" couplings. Duct to duct connections require fitting size "CD" couplings.

## **JOINT SEALING**

Fitting ends are equipped with factory installed, triple-lipped gaskets. When installed in a spiral duct per manufacturer's installation instructions, the gasket creates a seal against the interior of the spiral duct. The system tightness shall be factory warranted to meet SMACNA's Leakage Class 3 performance.

If no gasket is used, all joints must be sealed by the installer during the installation process. The type of sealant used as well as the method and level of application should be as directed by the specification and in accordance with the sealant manufacturer's published installation instructions.


## **GASKET**

The gasket shall be EPDM rubber. The gasket is located in a groove at the end of the fitting and securely fastened by means of an adhesive. In order to achieve optimum sealing for all diameters, different size gaskets shall be used. The gasket shall be classified by Underwriters Laboratories for flame spread and smoke developed 0 / 0 in accordance with ASTM E84-91a. A silicone gasket meeting the same performance may be offered by duct manufacturer for special applications.




# Tolerance, Gauge, & e-dimensions

## Tolerances for Spiral Duct

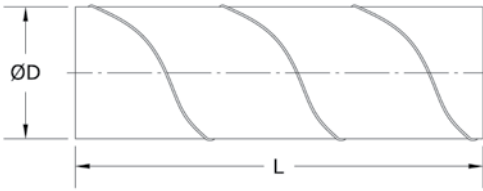

Ø D (inch)	Ø D Tolerance (inch) min.-max.	t* (gauge)	t** (gauge)
3	2.950 - 2.969	28	28
4	3.950 - 3.969	28	28
5	4.950 - 4.969	28	28
6	5.950 - 5.969	28	28
7	6.950 - 6.972	28	28
8	7.950 - 7.972	28	28
9	8.950 - 8.972	28	28
10	9.950 - 9.976	28	28
11	10.950 - 10.976	28	28
12	11.950 - 11.976	28	28
14	13.950 - 13.976	28	28
16	15.936 - 15.969	26	26
18	17.936 - 17.969	26	26
20	19.936 - 19.972	26	26
22	21.936 - 21.972	26	26
24	23.936 - 23.976	26	26
26	25.936 - 25.976	24	24
28	27.934 - 27.976	24	24
30	29.924 - 29.969	24	24
32	31.924 - 31.976	24	24
34	33.924 - 33.976	24	24
36	35.924 - 35.988	24	24
38	37.912 - 37.976	24	24
40	39.912 - 39.976	24	24
42	41.912 - 41.976	24	24
44	43.912 - 43.988	22	22
46	45.912 - 45.998	22	22
48	47.912 - 47.988	22	22
50	49.912 - 49.988	22	22

## Tolerances for Fittings



Ødx (inch)	Ødx Tolerance (inch) min.- max.	t* (gauge)	Die Stamped t** (gauge)	Fabricated t** (gauge)	e (inch)
3	2.902 - 2.917	28	24	-----	1.625
4	3.902 - 3.917	28	24	-----	1.625
5	4.902 - 4.917	28	24	-----	1.625
6	5.898 - 5.917	28	24	-----	1.625
7	6.894 - 6.913	28	24	-----	1.625
8	7.890 - 7.913	28	24	-----	1.625
9	8.886 - 8.909	28	24	-----	1.625
10	9.882 - 9.909	28	24	-----	2.375
11	10.882 - 10.909	28	24	-----	2.375
12	11.882 - 11.909	28	24	-----	2.375
14	13.878 - 13.909	28	-----	24	2.375
16	15.862 - 15.898	26	-----	24	3.125
18	17.862 - 17.898	26	-----	24	3.125
20	19.858 - 19.898	24	-----	24	3.125
22	21.858 - 21.898	24	-----	24	3.125
24	23.854 - 23.898	24	-----	24	3.125
26	25.854 - 25.898	22	-----	22	3.125
28	27.846 - 27.894	22	-----	22	4.000
30	29.839 - 29.886	22	-----	22	4.000
32	31.835 - 31.886	22	-----	22	4.000
34	33.835 - 33.886	22	-----	22	4.000
36	35.831 - 35.886	22	-----	22	4.000
38	37.819 - 37.874	22	-----	20	4.000
40	39.819 - 39.874	22	-----	20	4.750
42	41.819 - 41.874	22	-----	20	4.750
44	43.815 - 43.874	20	-----	20	4.750
46	45.815 - 45.874	20	-----	20	4.750
48	47.815 - 47.874	20	-----	20	4.750
50	49.815 - 49.874	20	-----	20	4.750

\* In accordance with the latest SMACNA HVAC Duct Construction Standards for +10" wg

\*\* EHG Manufacturing Standard  
"-----" = Not currently available


## Length Tolerances

Length - L, H, e, D, d (inch)	Tolerances (inch)
1 - 10	± 1/8
12 - 16	± 1/8
18 - 28	± 3/16
30 - 50	± 1/4
52 - 60	± 1/2

Weight Tolerance  
±10%

Thickness Tolerance  
±10%


Angular Tolerance



## Fitting Dimension For Flange Connections

Our products are designed with a male/female slip connections. For EHG G3 Connections, refer to the e-dimension listed in the chart above.


Factory-applied Flange	
Collar Length	Make-up Length
3"	3" + flange thickness

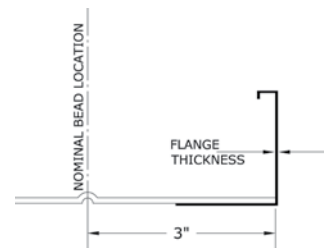

## Surface/Finish

Stainless steel fittings provided with a 2B mill finish.

Coated products have a minimum surface hardness of 2H when tested per ASTM D33-63-92A with an average thickness of 4 mils. ProCoat™ (OD only) or ProCoat™ Plus (ID & OD) coated duct.

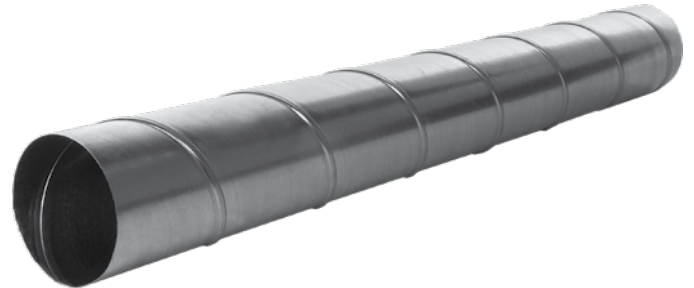

Description


corrugated spiral lock seam duct

- SMACNA RL-1 spiral seam
- evenly spaced integral seam locking feature
- multiple corrugations on all duct 8" - 60" all other diameters available upon request
- standard lengths: 120" built in accordance with the latest SMACNA HVAC Duct Construction Standard:
  - G90, S304, S316 = +10 iwg
  - Aluminium = +2 iwg
- available lengths:
  - G90 and GN - 12" - 240"
  - S4 and S6 - 12" - 240"
  - AL - 12" - 120"

Description

non corrugated spiral lock seam duct

- SMACNA RL-1 spiral seam
- evenly spaced integral seam locking feature
- available in diameters 3"- 60" all other diameters available upon request
- standard lengths: 120" built in accordance with the latest SMACNA HVAC Duct Construction Standard:
  - G90, S304, S316 = +10 iwg
  - Aluminium = +2 iwg
- available lengths:
  - G90 and GN - 12" - 240"
  - S4 and S6 - 12" - 240"
  - AL - 12" - 120"

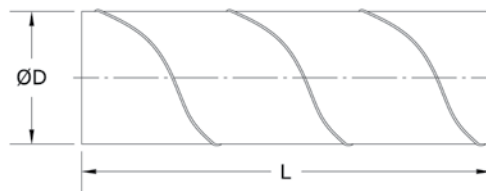

Ød	Ød	Length	Material	Thickness
8" - 60" 3" - 60"	SC = Spiral Pipe Corrugated SN = Spiral Pipe Non-corrugated	12" - 240" AL Only - 12" - 120"	G9 = G90 Galvanized S4 = S304 Stainless S6 = S316 Stainless GN = Galvanneal / Paint Grip AL = Aluminium	26"

16

SC

120

G9

26


Smart Part Number: **16SC120G926**



### Description

1.5" radius 90° elbow


- die stamped
- continuous stitch welded
- rolled edges
- **galvanized steel only**
- available in diameters 3" - 12"  
note: 11" diameter is fabricated

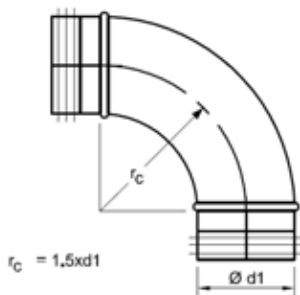

### Description

1.5" radius 90° elbow

- 5-piece gored
- internally sealed
- available in diameters 14" - 48"  
note: E 90 elbows 50" diameter and larger supplied as two E 45 elbows and a CF coupling

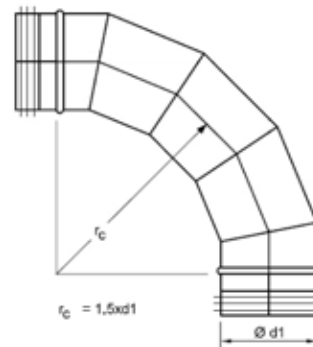

Order Example

Connection	Ød1	Designation	Angle	Material	Thickness
G= G3	16	E= Elbow	90	G9	24

G

16

E

90

G9

24


Smart Part Number: **G16E90G924**



Description

1.0" radius 90° elbow


- die stamped
- continuous stitch welded
- rolled edges
- **galvanized steel only**
- available in diameters 3" - 12"  
note: 11" diameter is fabricated

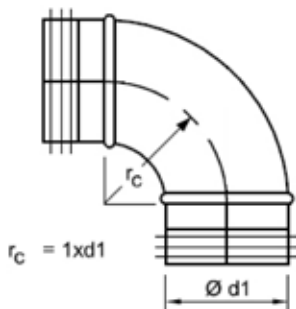

Description

1.0" radius 90° elbow

- 4-piece gored
- internally sealed
- available in diameters 14" - 48"  
*note: ER 90 elbows 50" diameter and larger supplied as two ER 45 elbows and a CF coupling*



Order Example

Connection	Ød1	Designation	Angle	Material	Thickness
G= G3	3" - 12" = Stamped 14" - 48" = Gored	ER = Elbow	90	G9	24

**G**                      **16**                      **ER**                      **90**                      **G9**                      **24**


Smart Part Number: **G16ER90G924**



Description

1.0" radius 60° elbow


- die stamped
- continuous stitch welded
- rolled edges
- **galvanized steel only**
- available in diameters 3" - 12"  
note: 11" diameter is fabricated



Description

1.0" radius 60° elbow

- 3-piece gored
- internally sealed
- available in diameters 14" - 48"



Order Example

Connection	Ød1	Designation	Angle	Material	Thickness
G= G3	3" - 12" = Stamped 14" - 48" = Gored	ER = Elbow	60	G9	24

**G**

**16**

**ER**

**60**

**G9**

**24**


Smart Part Number: **G16ER60**



Description

1.5" radius 45° elbow


- die stamped
- continuous stitch welded
- rolled edges
- **galvanized steel only**
- available in diameters 3" - 12"  
note: 11" diameter is fabricated

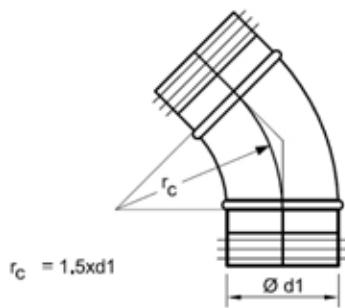

Description

1.5" radius 45° elbow

- 3-piece gored
- internally sealed
- available in diameters 14" - 48"

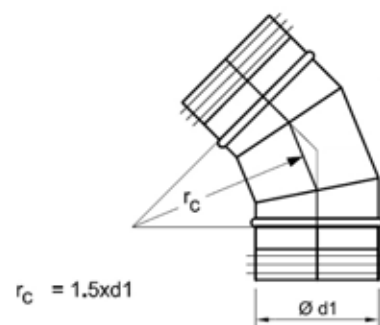

Order Example

Connection	Ød1	Designation	Angle	Material	Thickness
G= G3	3" - 12" = Stamped 14" - 48" = Gored	E = Elbow	45	G9	24

**G 16 E 45 G9 24**


Smart Part Number: **G16E45G924**



Description

1.0" radius 45° elbow


- die stamped
- continuous stitch welded
- rolled edges
- **galvanized steel only**
- available in diameters 3" - 12"  
note: 11" diameter is fabricated

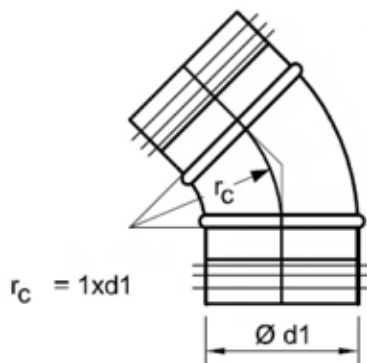

Description

1.0" radius 45° elbow

- 3-piece gored
- internally sealed
- available in diameters 14" - 48"

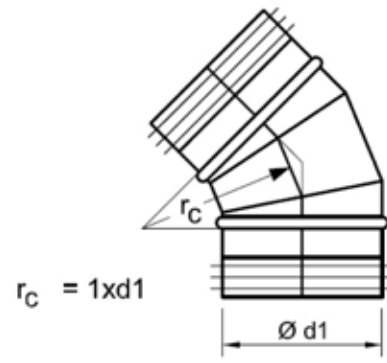

Order Example

Connection	Ød1	Designation	Angle	Material	Thickness
G= G3	3" - 12" = Stamped 14" - 48" = Gored	ER = Elbow	45	G9	24
<b>G</b>	<b>16</b>	<b>ER</b>	<b>45</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G16ER45G924**






Description

1.0" radius 30° elbow


- die stamped
- continuous stitch welded
- rolled edges
- **galvanized steel only**
- available in diameters 3" - 12"  
note: 11" diameter is fabricated

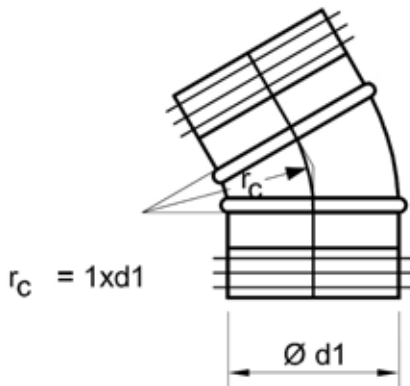

Description

1.0" radius 30° elbow

- 2-piece gored
- internally sealed
- available in diameters 14" - 48"

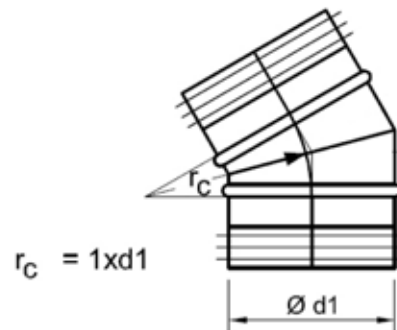

Order Example

Connection	Ød1	Designation	Angle	Material	Thickness
G= G3	3" - 12" = Stamped 14" - 48" = Gored	ER = Elbow	30	G9	24

G

16

ER

30

G9

24


Smart Part Number: **G16ER30G924**



Description

1.0" radius 15° elbow


- die stamped
- continuous stitch welded
- rolled edges
- **galvanized steel only**
- available in diameters 3" - 12"  
note: 11" diameter is fabricated

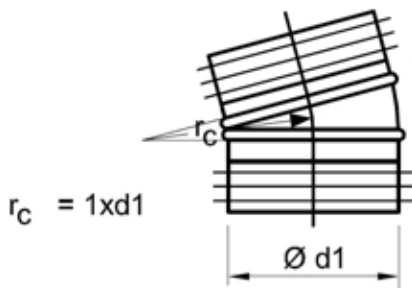

Description

1.0" radius 15° elbow

- 2-piece gored
- internally sealed
- available in diameters 14" - 48"

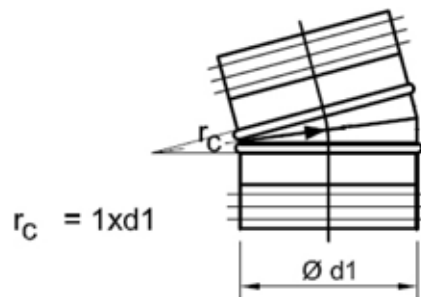

Order Example


Connection	Ød1	Designation	Angle	Material	Thickness
G= G3	3" - 12" = Stamped 14" - 48" = Gored	ER = Elbow	15	G9	24
<b>G</b>	<b>16</b>	<b>ER</b>	<b>15</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G16ER15G924**




Description  
mitered elbow

- rolled edge
- 2" standard throat length
- available in diameters 4"- 60"

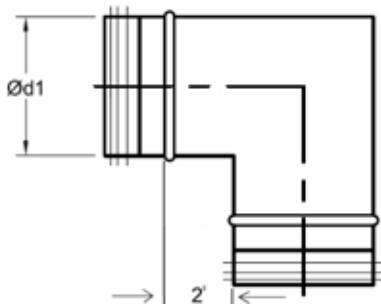

Description  
mitered elbow with vanes

- rolled edge
- 2" standard throat length
- turning vanes evenly spaced
- available in diameters 4"- 60"  
number of vanes vary by diameter
  - Ø 4"-10" = 2 vanes
  - Ø 12"-14" = 3 vanes
  - Ø 16"-20" = 4 vanes
  - Ø 22"-60" = 5 vanes

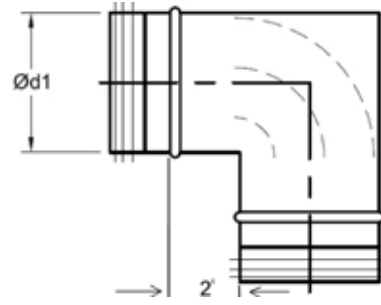


Order Example

Connection	Dia (Inch)	Designation	Material	Thickness
G= G3	4" - 60"	EM = Mitered Elbow EMV = Mitered with vanes	G9	24

**G**      **16**      **EM**      **G9**      **24**

Smart Part Number: **G16EMG924**

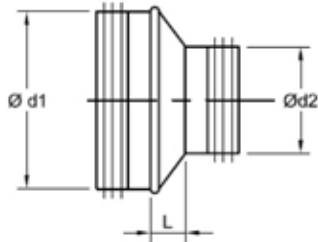


Description

concentric reducer

- galvanized construction only

Dimension (die stamped)

$\varnothing d1$ inch	$\varnothing d2$ inch	L inch
4	3	3/4
5	3	1
5	4	7/8
6	3	1 1/4
6	4	1 1/4
6	5	3/4
7	4	2
7	5	1 1/2
7	6	1
8	4	2 1/4
8	5	1 5/8
8	6	1 1/4
8	7	3/4
9	7	2 1/8
9	8	1 1/8
10	6	2 1/4
10	7	1 5/8
10	8	1 1/8
10	9	5/8
12	8	2 1/8
12	10	1 3/8
14	10	2
14	12	1 5/8

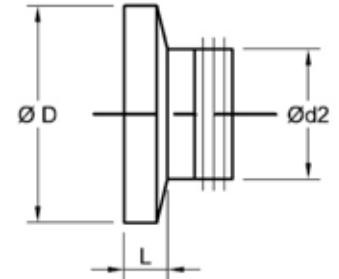

Description

concentric reducer

- $\varnothing D$  = duct size slips over fitting end
- galvanized construction only

Dimension (die stamped)

$\varnothing d1$ inch	$\varnothing d2$ inch	L inch
4	3	2 3/8
5	3	2 5/8
5	4	2 3/8
6	3	3 3/8
6	4	2 7/8
6	5	2 3/8
7	4	3 1/2
7	5	3
7	6	2 1/2
8	4	3 3/4
8	5	3 1/4
8	6	2 7/8
8	7	2 3/8
9	7	3 3/4
9	8	2 3/4
10	6	4 3/8
10	7	3 1/4
10	8	2 3/4
10	9	2 1/4
12	10	2 3/4
14	10	4 3/4
14	12	3 5/8

Order Example


Connection	$\varnothing d1$ / $\varnothing D$	Designation	$\varnothing d2$	Material	Thickness
G= G3	Diameter	RC = Concentric Reducer Male RCF = Concentric Reducer Female	3" - 12"	G9	24
<b>G</b>	<b>14</b>	<b>RC</b>	<b>12</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G14RC12G924**




Description  
fabricated concentric reducer

- $L1 = (\text{Ø}d1 - \text{Ø}d2)^*$   
( \* ) minimum 4"

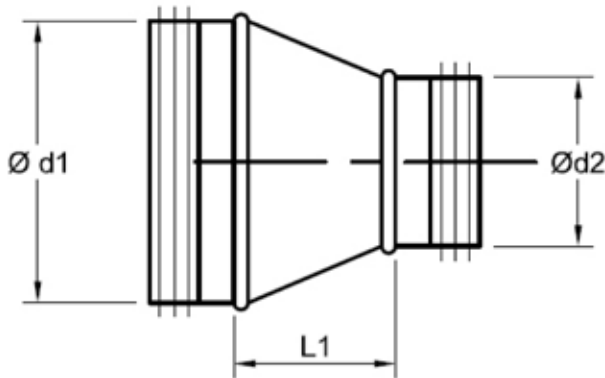

Description  
fabricated concentric reducer

- $\text{Ø}D$  end slips onto fitting end
- $L1 = (\text{Ø}D - \text{Ø}d2)^* + e$  dimension (page 11)  
( \* ) minimum 4"

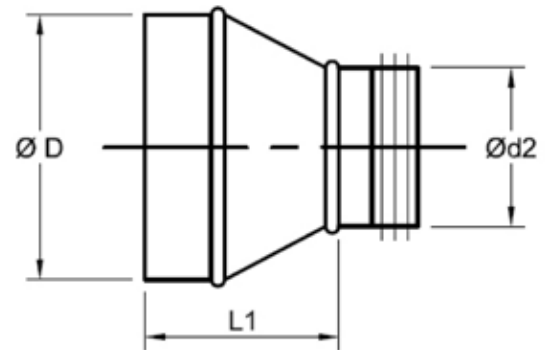

Order Example


Connection	Ød1 / ØD	Designation	Ød2	Material	Thickness
G = G3	Diameter	RC = Concentric Reducer RCF = Concentric Reducer Female	Diameter	G9	24
<b>G</b>	<b>16</b>	<b>RC</b>	<b>14</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G16RC14G924**




Description  
fabricated eccentric reducer

- $L1 = (\text{Ø}d1 - \text{Ø}d2)^*$   
( \* ) minimum 4"

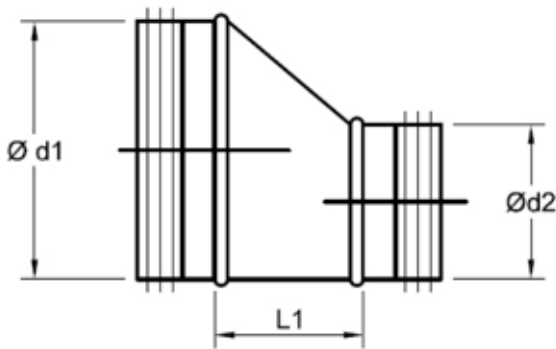

Description  
fabricated eccentric reducer

- $\text{Ø}D$  end slips onto fitting end
- $L1 = (\text{Ø}D - \text{Ø}d2)^* + e$  dimension (page 11)  
( \* ) minimum 4"

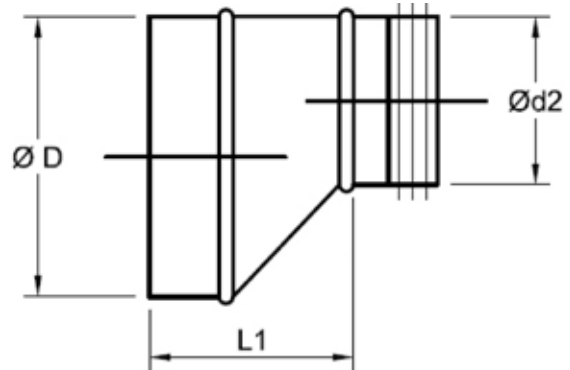

Order Example

Connection	Ød / ØD	Designation	Ød2	Material	Thickness
G= G3	Diameter	RE = Eccentric Reducer REF = Eccentric Reducer Female	Diameter	G9	24
<b>G</b>	<b>16</b>	<b>RC</b>	<b>14</b>	<b>G9</b>	<b>24</b>


Smart Part Number: **G16RC14G924**



Description  
45° combination boot-style saddle tap

Dimensions

- If  $\text{Ød3} \leq 8''$ ,  $H = 4''$
- If  $\text{Ød3} = 9''\text{-}14''$ ,  $H = 7''$
- If  $\text{Ød3} = 15''\text{-}26''$ ,  $H = 10''$
- If  $\text{Ød3} = 27''\text{-}46''$ ,  $H = 13''$
- If  $\text{Ød3} = 47''\text{-}60''$ ,  $H = 16''$

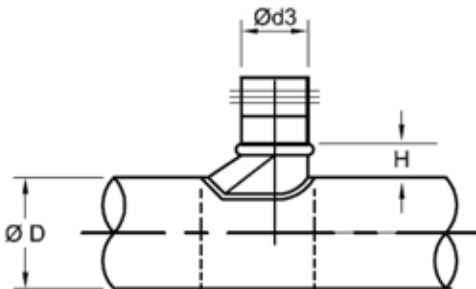

Order Example

Connection	Ød3	Designation	ØD	Material	Thickness
G= G3	Fitting Diameter	PB = Combination boot-style saddle tap	Duct Diameter	G9	24

**G**      **16**      **PB**      **00**      **G9**      **24**

Smart Part Number: **G16PB00G924**




Description  
45° boot-style tap

- installed on flat side of duct or plenum

Dimensions

- If  $\text{Ød3} \leq 8''$   $H = 4''$
- If  $\text{Ød3} = 9''\text{-}14''$ ,  $H = 7''$
- If  $\text{Ød3} = 15''\text{-}26''$ ,  $H = 10''$
- If  $\text{Ød3} = 27''\text{-}46''$ ,  $H = 13''$
- If  $\text{Ød3} = 47''\text{-}60''$ ,  $H = 16''$

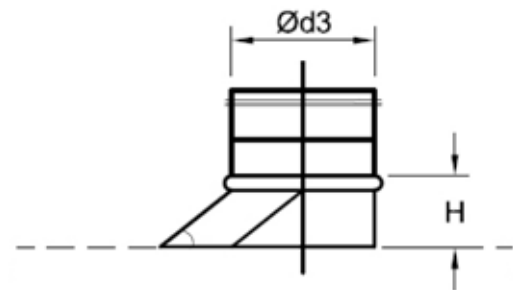

Order Example



Connection	Ød3	Designation	Material	Thickness
G= G3	Fitting Diameter	PBF = Boot-style tap	G9	24

**G**      **14**      **PBF**      **G9**      **24**

Smart Part Number: **G14PBF G924**



# Taps

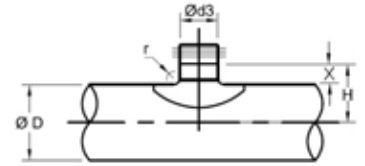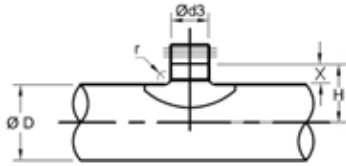

## Description

pressed saddle tap

- radius entry
- limited to galvanized steel only
- available in Ød3 or tap diameters 3"-16", exceptions listed below

## Description

fabricated saddle tap

- sizes listed below
- X = 1"

Pressed Saddle Taps - Ød3 (inch)											
ØD (inch)	3	4	5	6	7	8	9	10	12	14	16
4	X	X									
5	X	X	X								
6	X	X	X	X							
7	X	X	X	X	X						
8		X	X	X	X	X					
9		X	X	X		X	X				
10		X	X	X		X	X	X			
12		X	X	X		X	X	X	X		
14		X	X	X		X	X	X	X		
16		X	X	X		X	X	X	X		X
18		X	X	X		X	X	X	X		X
20		X	X	X		X	X	X	X		X
22			X	X		X	X	X	X		X
24			X	X		X	X	X			X

### Order Example

Connection	Ød3	Designation	ØD	Material	Thickness
G= G3	Diameter	PS = Saddle tap	Diameter	G9	24

G 3 PS 7 G9 24


Smart Part Number: **G3PS7G924**



Description

fabricated 45° lateral tap for round


- H = 2.5"
- special order: 15°, 30°, 60°  
i.e. for a 15° G 12PV1520

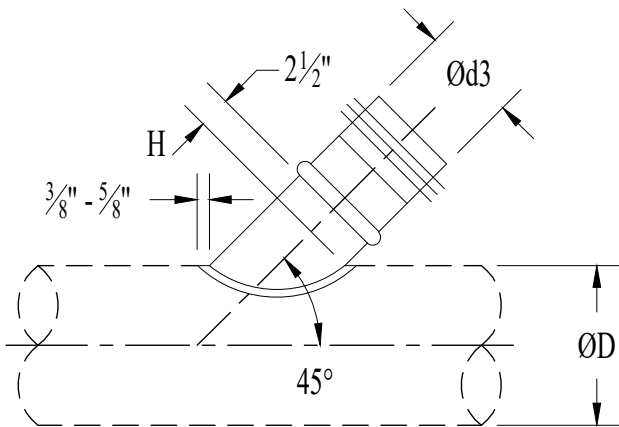

Description

conical saddle tap

- H = 6"
- L = Ød3 + 2"

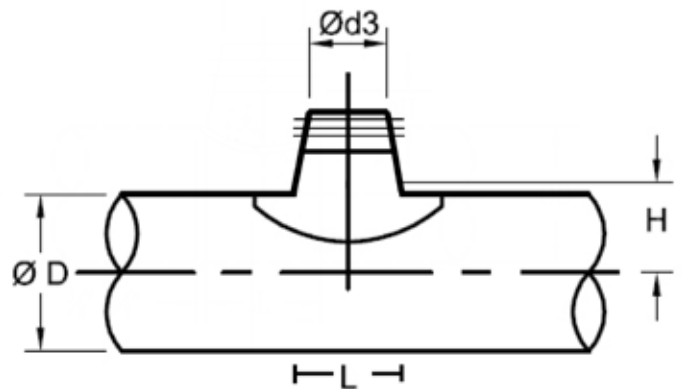

Order Example


Connection	Ød3	Designation	ØD	Material	Thickness
G = G3	Fitting Diameter	PV45 = 45° Lateral Tap Round PC = Conical Saddle Tap	Duct Diameter	G9	24
<b>G</b>	<b>22</b>	<b>PV45</b>	<b>32</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G22PV32G924**




Description  
fabricated 45° lateral tap for flat surface

- H = 2.5"
- special order: 15°, 30°, 60°  
i.e. for a 15° G 12PVF1520

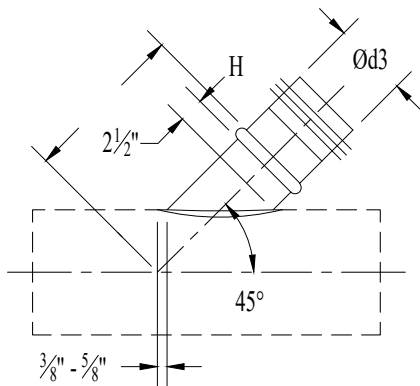

Description  
conical tap for flat surface

- H = 6"
- L = Ød3 + 2"
- flat lip = 3/8" - 5/8" depending on diameter

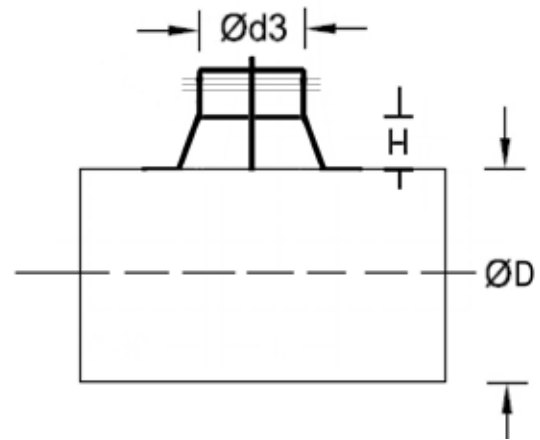

Order Example

Connection	Ød3	Designation	ØD	Material	Thickness
G = G3	Diameter	PV45 = 45° Lateral Tap Flat PC = Conical Saddle Tap Flat	Duct Diameter	G9	24
<b>G</b>	<b>12</b>	<b>PV45</b>	<b>32</b>	<b>G9</b>	<b>24</b>



Smart Part Number: **G12PV45G924**



Description  
bullhead tee

- $L = \text{Ød1} + 6''$

TBHV (with turning vanes) shown below.

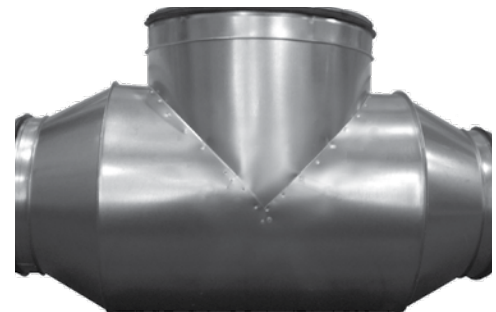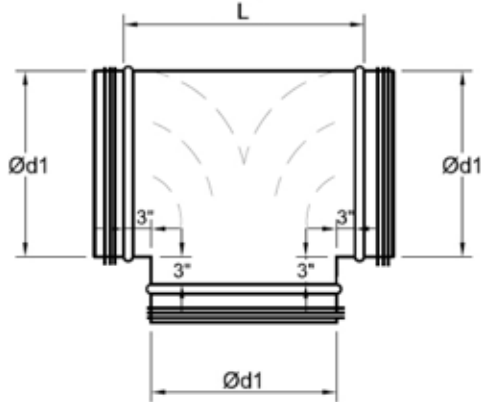


Description  
bullhead reducing tee

- $L = \text{Ød1} + 6''$
- $L1 = (\text{Ød1} - \text{Ød3})^*$
- $L2 = (\text{Ød1} - \text{Ød2})^*$

(\* ) minimum 4"

TRBHV (with turning vanes) shown below.

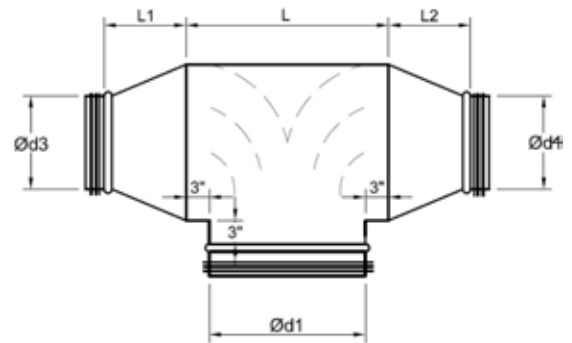

Order Example

Connection	Ød1	Designation	Ød1	Material	Thickness
G= G3	Diameter	TBH = Bullhead Tee TBHV = Bullhead Tee With Vanes	Diameter	G9	24

**G**    **14**    **TBH**    **14**    **G9**    **24**

Smart Part Number: **G14TBH14G924**

Order Example

Connection	Ød1	Designation	Ød3	Ød4	Material	Thickness
G= G3	Diameter	TRBH = Bullhead Tee With Reducer TRBHV = Bullhead Tee With Reducer With Vanes	Diameter	Diameter	G9	24

**G**    **14**    **TRBH**    **12**    **12**    **G9**    **24**


Smart Part Number: **G14TRBH1212G924**



Description

45° boot-style tee

- assembled with PB tap
- $\text{Ød3} \leq \text{Ød1}$  diameter
- $L2 = \text{Ød3} + H2 + 4"$
- If  $\text{Ød3} \leq 8"$ ,  $H2 = 4"$ ,  
If  $\text{Ød3} = 9-14"$ ,  $H2 = 7"$ ,  
If  $\text{Ød3} = 15-26"$ ,  $H2 = 10"$ ,  
If  $\text{Ød3} = 27-46"$ ,  $H2 = 13"$ , and  
If  $\text{Ød3} = 47-60"$ ,  $H2 = 16"$

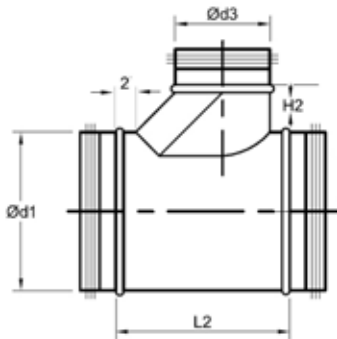

Order Example

Connection	Ød1	Designation	Ød3	Material	Thickness
G= G3	Diameter	TB = 45° Boot-Style Tee	Diameter	G9	24

G 22 TB 12 G9 24

Smart Part Number: **G22TB12G924**




Description

45° boot-style tee with reducer

- assembled with PB tap
- $\text{Ød3} \leq \text{Ød1}$  diameter
- $L2 = (\text{Ød3} + H2 + 4") + (\text{Ød1} - \text{Ød2})^*$
- If  $\text{Ød3} \leq 8"$ ,  $H2 = 4"$ ,  
If  $\text{Ød3} = 9-14"$ ,  $H2 = 7"$ ,  
If  $\text{Ød3} = 15-26"$ ,  $H2 = 10"$ ,  
If  $\text{Ød3} = 27-46"$ ,  $H2 = 13"$ , and  
If  $\text{Ød3} = 47-60"$ ,  $H2 = 16"$

(\* ) minimum of 4"

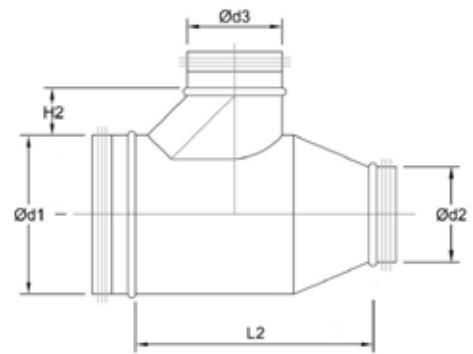

Order Example

Connection	Ød1	Designation	Ød2	Ød3	Material	Thickness
G= G3	Diameter	TRB = 45° Boot-Style Tee With Reducer	Diameter	Diameter	G9	24

G 22 TRB 16 12 G9 24


Smart Part Number: **G22TRB1612G924**



Description

45° boot-style crossing tee

- assembled with PB taps
- $\text{Ød3}$  and  $\text{Ød4} \leq \text{Ød1}$  diameter  
 $\text{Ød3} \geq \text{Ød4}$
- $L = \text{Ød3} + H2 + 4"$
- If  $\text{Ød3} \leq 8"$ ,  $H2 = 4"$ ,  
If  $\text{Ød3} = 9-14"$ ,  $H2 = 7"$ ,  
If  $\text{Ød3} = 15-26"$ ,  $H2 = 10"$ ,  
If  $\text{Ød3} = 27-46"$ ,  $H2 = 13"$ , and  
If  $\text{Ød3} = 47-60"$ ,  $H2 = 16"$




Order Example

Connection	Ød1	Designation	Ød3	Ød4	Material	Thickness
G= G3	Diameter	XB = 45° Boot-Style Crossing Tee	Diameter	Diameter	G9	24

**G 14 XB 12 12 G9 24**

Smart Part Number: **G14XB1212G924**

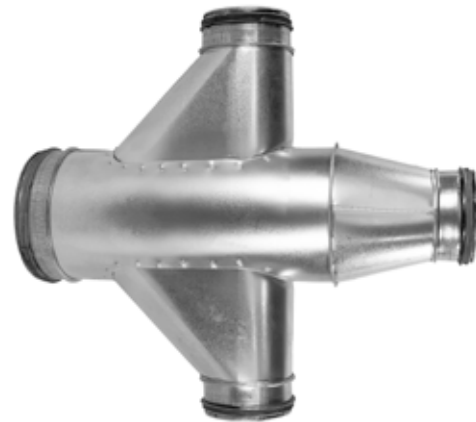


Description

45° boot-style crossing tee with reducer

- assembled with PB taps
- $\text{Ød3}$  and  $\text{Ød4} \leq \text{Ød1}$  diameter  
 $\text{Ød3} \geq \text{Ød4}$
- $L = (\text{Ød3} + H2 + 4") + (\text{Ød1} - \text{Ød2})^*$
- If  $\text{Ød3} \leq 8"$   $H2 = 4"$ ,  
If  $\text{Ød3} = 9-14"$ ,  $H2 = 7"$ ,  
If  $\text{Ød3} = 15-26"$ ,  $H2 = 10"$ ,  
If  $\text{Ød3} = 27-46"$ ,  $H2 = 13"$ , and  
If  $\text{Ød3} = 47-60"$ ,  $H2 = 16"$

(\* ) minimum of 4"



Order Example

Connection	Ød1	Designation	Ød2	Ød3	Ød4	Material	Thickness
G= G3	Diameter	XRB = 45° Boot-Style Crossing Tee With Reducer	Diameter	Diameter	Diameter	G9	24


**G 14 XRB 12 12 12 G9 24**

Smart Part Number: **G14XRB121212G924**



Description  
conical tee

- $L = \text{Ø}d3 + 8"$
- $H = 6"$
- $\text{Ø}d1$  must be 2" or larger than  $\text{Ø}d3$

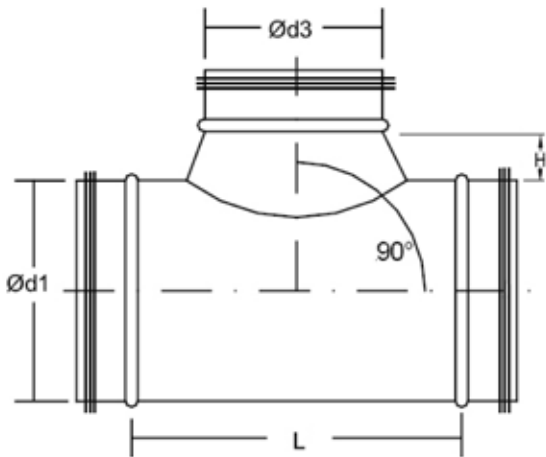

Order Example


Connection	Ød1	Designation	Ød3	Material	Thickness
G= G3	Diameter	TC = Conical Reducing Tee	Diameter	G9	24
<b>G</b>	<b>14</b>	<b>TC</b>	<b>12</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G14TC12G924**



Description  
conical reducing tee

- $L = (\text{Ø}d3 + 8") + (\text{Ø}d1 - \text{Ø}d2)^*$
- $H = 6"$
- $\text{Ø}d1$  must be 2" or larger than  $\text{Ø}d3$
- ( \* ) minimum of 4"

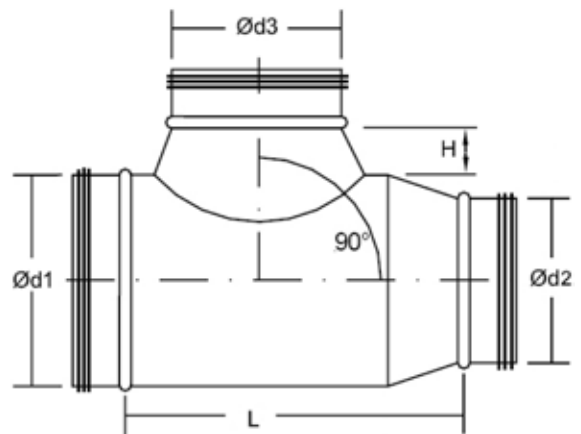

Order Example

Connection	Ød1	Designation	Ød2	Ød3	Material	Thickness
G= G3	Diameter	TRC = Conical Reducing Tee With Reducer	Diameter	Diameter	G9	24
<b>G</b>	<b>14</b>	<b>TRC</b>	<b>12</b>	<b>12</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G14TRC1212G924**




# Crossing Tees

30




Description  
conical crossing tee

- $L = \text{Ød3} + 8''$
- $H = 6''$
- $\text{Ød1}$  must be 2" or larger than  $\text{Ød3}$
- $\text{Ød3} \geq \text{Ød4}$

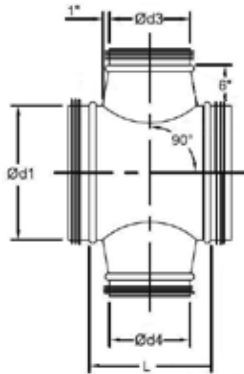

Description  
conical reducing crossing tee

- $L = (\text{Ød3} + 8'') + (\text{Ød1} - \text{Ød2})^*$
  - $H = 6''$
  - $\text{Ød1}$  must be 2" or larger than  $\text{Ød3}$
  - $\text{Ød3} \geq \text{Ød4}$
- (\* ) minimum of 4"

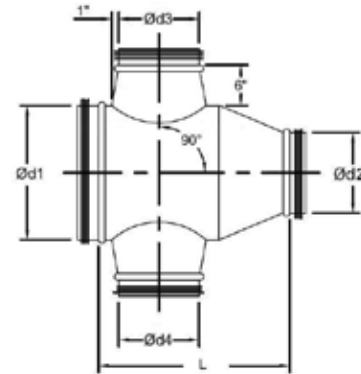

Order Example

Connection	Ød1	Designation	Ød3	Ød4	Material	Thickness
G= G3	Diameter	XC = Conical Crossing Tee	Diameter	Diameter	G9	24

**G 14 XC 12 12 G9 24**

Smart Part Number: **G14XC1212G924**

Order Example

Connection	Ød1	Designation	Ød2	Ød3	Ød4	Material	Thickness
G= G3	Diameter	XRC = Conical Crossing Tee With Reducer	Diameter	Diameter	Diameter	G9	24


**G 14 XRC 12 12 12 G9 24**

Smart Part Number: **G14XRC121212G924**



Description  
 assembled tee with die-stamped or fabricated PS

- $L = \text{Ød3} + 6''$

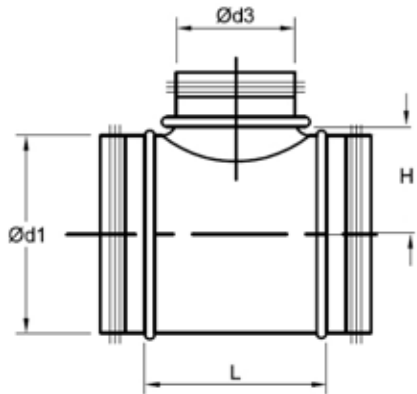

Order Example

Connection	Ød1	Designation	Ød3	Material	Thickness
G= G3	Diameter	TS = Assembled Tee	Diameter	G9	24


**G**    **14**                      **TS**                      **12**    **G9**    **24**

Smart Part Number: **G14TS12G924**



Description  
 assembled reducing tee with die-stamped or fabricated PS

- $L = (\text{Ød3} + 6'') + (\text{Ød1} - \text{Ød2})^*$
- (\* ) minimum of 4"

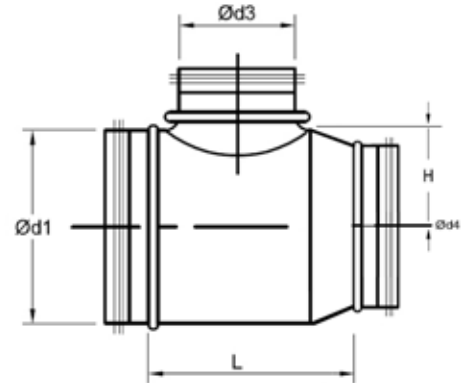

Order Example

Connection	Ød1	Designation	Ød2	Ød3	Material	Thickness
G= G3	Diameter	TRS = Assembled Tee With Reducer	Diameter	Diameter	G9	24

**G**    **14**                      **TRS**                      **12**    **12**    **G9**    **24**


Smart Part Number: **G14TRS1212G924**

# Crossing Tees




Description  
assembled crossing tee with die-stamped or fabricated PS

- $\text{Ød3} \geq \text{Ød4}$
- $L = \text{Ød3} + 6''$

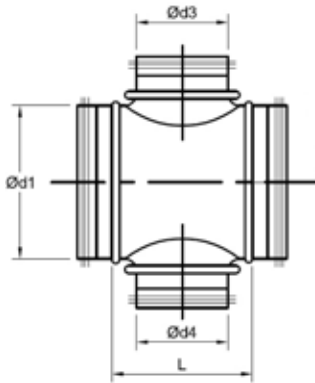

Description  
assembled reducing crossing tee with die-stamped or fabricated PS

- $\text{Ød3} \geq \text{Ød4}$
  - $L = (\text{Ød3} + 6'') + (\text{Ød1} - \text{Ød2})^*$
- (\* ) minimum of 4"

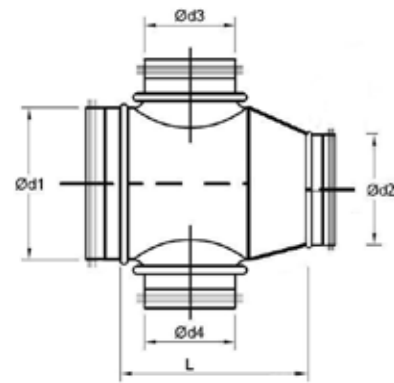

Order Example						
Connection	Ød1	Designation	Ød3	Ød4	Material	Thickness
G= G3	Diameter	XS = Assembled Crossing Tee	Diameter	Diameter	G9	24
<b>G</b>	<b>14</b>	<b>XS</b>	<b>12</b>	<b>12</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G14XS1212G924**

Order Example							
Connection	Ød1	Designation	Ød2	Ød3	Ød4	Material	Thickness
G= G3	Diameter	XRS = Assembled Tee With Reducer	Diameter	Diameter	Diameter	G9	24
<b>G</b>	<b>14</b>	<b>XRS</b>	<b>12</b>	<b>12</b>	<b>12</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G14XRS121212**





Description  
45° lateral tee

- $L = \text{Ø}d3[1/\sin(45)] + 4"$
- H = 2.5" (constant)(throat height)
- special order: 15°- 30°- 60°  
i.e. G - Ød1 - TV15 - Ød3

Description  
45° lateral reducing tee

- $L = \text{Ø}d3 [1/\sin(45)] + 4" + (\text{Ø}d1 - \text{Ø}d2)^*$
- H = 2.5" (constant) (throat height)
- ( \* ) minimum of 4

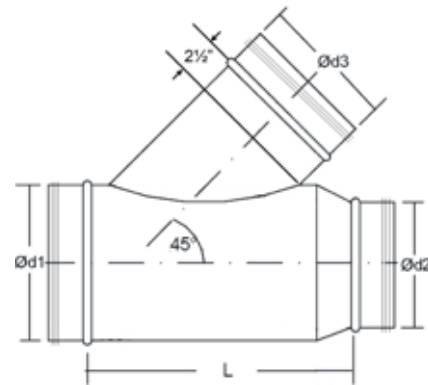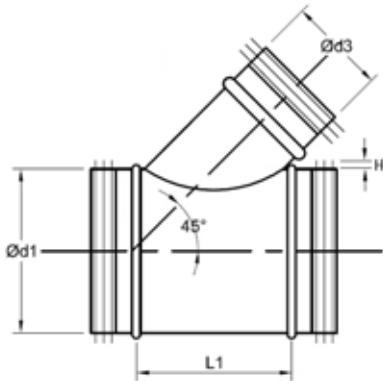

Order Example

Connection	Ød1	Designation	Ød3	Material	Thickness
G= G3	Diameter	TV = 45° Lateral Tee	Diameter	G9	24
<b>G</b>	<b>14</b>	<b>TR</b>	<b>Ø8</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G14TR08G924**

Order Example

Connection	Ød1	Designation	Ød2	Ød3	Material	Thickness
G= G3	Diameter	TRV = 45° Lateral Tee With Reducer	Diameter	Diameter	G9	24
<b>G</b>	<b>14</b>	<b>TRV</b>	<b>12</b>	<b>Ø8</b>	<b>G9</b>	<b>24</b>


Smart Part Number: **G14TRV1208G924**



Description

45° lateral crossing tee


- dimension data for  $\text{Ød4} = \text{Ød3}$  only  
 $L = (1.414 \times \text{Ød3}) + 4"$
- $H = 2.5"$  (constant throat height)  
 $\text{Ød3} \geq \text{Ød4}$
- special order: 15° - 30° - 60°  
 i.e. XV 15° - aa - bb - cc

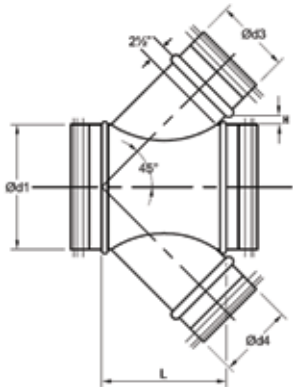

Description

45° lateral reducing crossing tee

- dimension data for  $\text{Ød4} = \text{Ød3}$  only  
 $L = (1.414 \times \text{Ød3}) + 4" + (\text{Ød1} - \text{Ød2})^*$
- $H = 2.5"$  (constant throat height)  
 $\text{Ød3} \geq \text{Ød4}$
- (\*) minimum of 4"

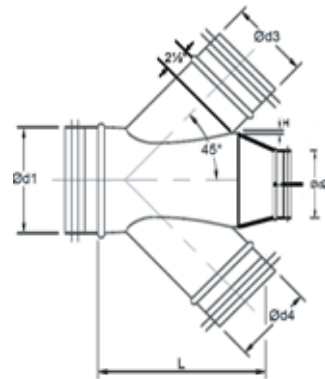

Order Example

Connection	Ød1	Designation	Ød3	Ød4	Material	Thickness
G= G3	Diameter	XV = 45° Lateral Crossing Tee	Diameter	Diameter	G9	24

**G 14 XV 12 12 G9 24**

Smart Part Number: **G14XV1212G924**


Order Example

Connection	Ød1	Designation	Ød2	Ød3	Ød4	Material	Thickness
G= G3	Diameter	XRV = 45° Lateral Crossing Tee With Reducer	Diameter	Diameter	Diameter	G9	24

**G 14 XRV 12 12 12 G9 24**

Smart Part Number: **G14XRV121212G924**

# Y-branch

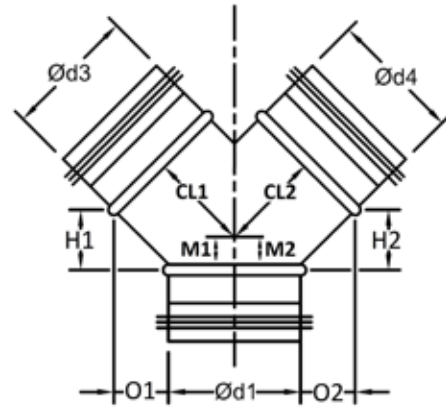

## Description

directional split fitting: 45°

- special order: 15°, 30°, 60°  
i.e. Y 15° - aa - bb - cc
- special order: Ød3 or Ød4 < Ød1
- special order: Ød3 ≤ Ød4

## Dimensions

$$H1 = [ (\text{Ød3} \times 0.5) + (\text{Ød1} \times 0.9) ] \times (\text{Ød3} \times 0.5)$$

$$O1 = [ (\text{Ød3} \times 0.5) + (\text{Ød1} \times 0.8) ] \times (\text{Ød1} \times 0.5)$$

$$H2 = [ (\text{Ød4} \times 0.5) + (\text{Ød1} \times 0.9) ] \times (\text{Ød4} \times 0.5)$$

$$O2 = [ (\text{Ød4} \times 0.5) + (\text{Ød1} \times 0.8) ] \times (\text{Ød1} \times 0.5)$$

$$M1 = H1 + (\text{Ød3} \times 0.5) \cdot 0.707 - (\text{Ød1} \times 0.5) + O1 - (\text{Ød3} \times 0.5) \cdot 0.707$$

$$M2 = H2 + (\text{Ød4} \times 0.5) \cdot 0.707 - (\text{Ød1} \times 0.5) + O2 - (\text{Ød4} \times 0.5) \cdot 0.707$$

$$CL1 = [ (\text{Ød1} \times 0.5) + O1 - (\text{Ød3} \times 0.5) \cdot 0.707 ] / 0.707$$


$$CL2 = [ (\text{Ød1} \times 0.5) + O2 - (\text{Ød4} \times 0.5) \cdot 0.707 ] / 0.707$$

Note: These dimensions apply for 45° only. Please call for dimensions on special orders.

### Order Example

Connection	Ød1	Designation	Ød2	Ød3	Material	Thickness
G= G3	Diameter	Y = 45° Directional Split	Diameter	Diameter	G9	24
<b>G</b>	<b>16</b>	<b>Y</b>	<b>14</b>	<b>14</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G16Y1414G924**

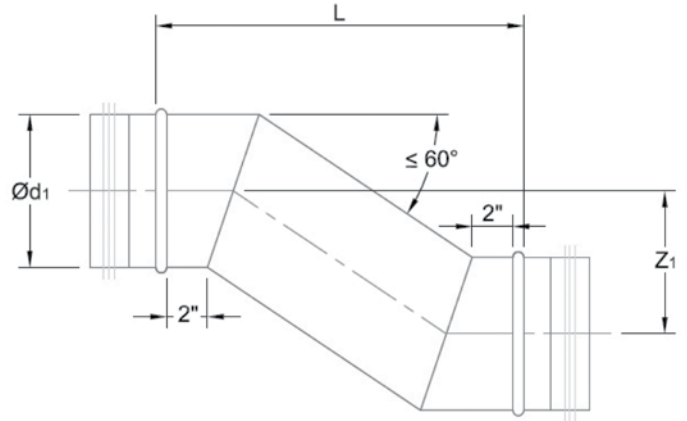

Description  
one-piece offset

- $L_{\min} = \left[ \frac{\text{Ø}d_1}{4} \right] + \left[ \frac{Z_1}{0.577} \right] + 4$
- $L_{\max} = 60''$

Note: SMACNA recommends that offsets be 60° or less

Order Example

Connection	Ød1	Designation	L	Z <sub>1</sub>	Material	Thickness
G= G3	Diameter	Z = Offset	Length ≥ Lmin (≤60°)	Offset Dimension	G9	24
<b>G</b>	<b>16</b>	<b>Z</b>	<b>12</b>	<b>20</b>	<b>G9</b>	<b>24</b>


Smart Part Number: **G16Z1220G924**






Description  
coupling used for joining spiral duct

- If  $\text{Ø } 3\text{"}-20\text{"}$ ,  $L = \frac{3}{8}\text{"}$ ,  
If  $\text{Ø } 22\text{"}-26\text{"}$ ,  $L = \frac{1}{2}\text{"}$   
If  $\text{Ø } 28\text{"}-60\text{"}$ ,  $L = \frac{5}{8}\text{"}$

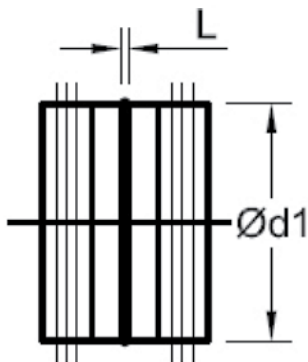

Description  
coupling for joining fittings

- If  $\text{Ø } 3\text{"}-9\text{"}$ ,  $L = \frac{3}{8}\text{"}$ ,  
If  $\text{Ø } 10\text{"}-14\text{"}$ ,  $L = \frac{5}{8}\text{"}$ ,  
If  $\text{Ø } 16\text{"}-26\text{"}$ ,  $L = \frac{6}{8}\text{"}$ ,  
If  $\text{Ø } 28\text{"}-38\text{"}$ ,  $L = \frac{8}{8}\text{"}$ ,  
If  $\text{Ø } 40\text{"}-60\text{"}$ ,  $L = \frac{10}{8}\text{"}$

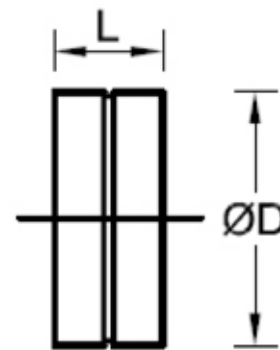

Order Example


Connection	Ød1 / Ød	Designation	Material	Thickness
G= G3	Diameter	CD = Coupling For Spiral CF = Coupling For Fitting	G9	24
<b>G</b>	<b>16</b>	<b>CD</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G16CDG924**




Description  
end cap for spiral duct

- If  $\text{Ø } 3''\text{-}20''$ ,  $L = \frac{3}{8}''$ ,  
If  $\text{Ø } 22''\text{-}26''$ ,  $L = \frac{1}{2}''$   
If  $\text{Ø } 28''\text{-}60''$ ,  $L = \frac{5}{8}''$

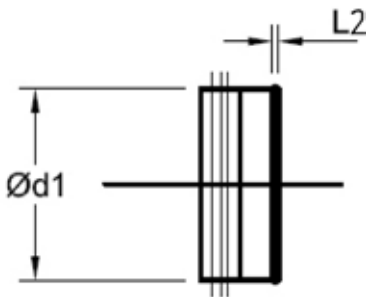

Description  
end cap for fittings

- If  $\text{Ø } 3''\text{-}9''$ ,  $L = 1\frac{5}{8}''$ ,  
If  $\text{Ø } 10''\text{-}14''$ ,  $L = 2\frac{3}{8}''$ ,  
If  $\text{Ø } 16''\text{-}26''$ ,  $L = 3\frac{1}{8}''$ ,  
If  $\text{Ø } 28''\text{-}38''$ ,  $L = 4''$ ,  
If  $\text{Ø } 40''\text{-}60''$ ,  $L = 4\frac{3}{4}''$



Order Example


Connection	Ød1 / Ød	Designation	Material	Thickness
G= G3	Diameter	ED = End Cap For Spiral EF = End Cap For Fitting	G9	24
<b>G</b>	<b>16</b>	<b>ED</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G16EDG924**




Description  
take-off/starting collar

- installed on flat side of duct or plenum
- available in diameters 3"- 60"

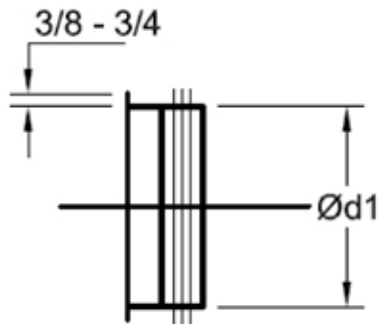

Description  
stamped radiused bellmouth take-off

- available in 4"-16" (not including 11")
- installed on flat side of duct or plenum

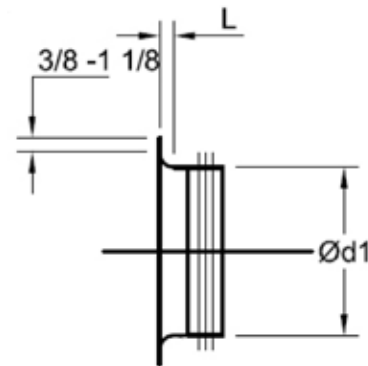

Order Example

Connection	Ød1	Designation	Material	Thickness
G= G3	3" - 60" = Take-Off Starting Collar 4" -16" = Bellmouth Take-Off	PT = Take-Off Starting Collar PR = Bellmouth Take-Off	G9	24

**G**

**16**

**PT**


**G9**

**24**

Smart Part Number: **G16PTG924**



DSG

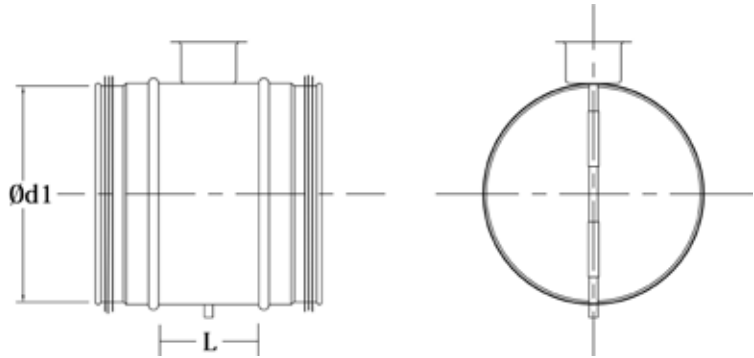

Description

manual balancing damper w/ full blade

- for use in systems where a complete shut-off of air flow is not required
- gasketed shaft-mounted load bearing bushing to minimize air leakage
- integral shaft-blade assembly
- 2" sheet metal insulation stand-off
- damper cup height = 2"
- locking blade quadrant w/damper position indicator
- full fitting body assembly with bead stop

Note:

- Ød1 > 14" equipped with extended handle and a reinforced damper blade
- Ød1 > 24" provided with 2" bracket stand-off

Dimension

Ød1 inch	'L' inch	Shaft inch x inch
4	3.9	5/16*
5	3.9	5/16*
6	3.9	5/16*
7	3.9	5/16*
8	3.9	5/16*
9	3.9	5/16*
10	3.5	5/16*
12	3.5	5/16*
14	3.5	5/16*
16	3.75	5/16*
18	3.75	5/16*
20	3.75	5/16*
22	3.75	5/16*
24	3.75	5/16*
26	3.75	5/16*
28	3.75	5/16*
30	3.75	5/16*
32	10.4	1**
34	10.4	1**
36	10.4	1**

\* 2" shaft extensions available  
\*\* 1" square tube shaft

Order Example

Connection	Ød1	Designation	Material	Thickness
G= G3	4" - 10" 12" - 36" in 2" Increments	DS = Balancing Damper With Full Blade	G9	24

**G**

**16**

**DS**

**G9**

**24**

Smart Part Number: **G16DSG924**



### Description

gasketed take-off with damper

- lengths (in):  
 diameters 4" - 9" : L= 5½"  
 diameters 10" - 14" : L= 5⅝"  
 diameters 16" - 24" : L= 6⅜"
- shaft = 5/16"
- 2" shaft extension available





### Description

gasketed bellmouth take-off with damper

- assembled with PR radiused bellmouth take-off
- lengths:  
 diameters 4" - 9" : L= 7⅞"  
 diameters 10" - 14" : L= 9"  
 diameters 16" : L= 10¼"
- shaft = 5/16"
- 2" shaft extension available

Note: 11" is not available

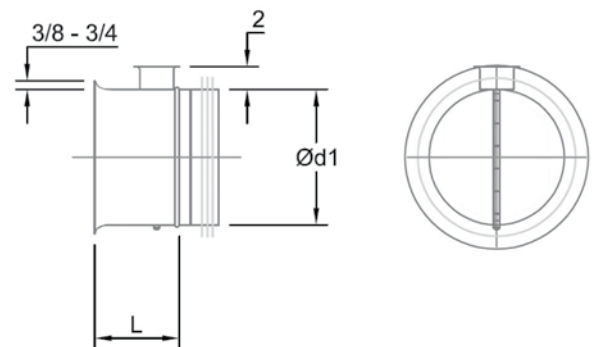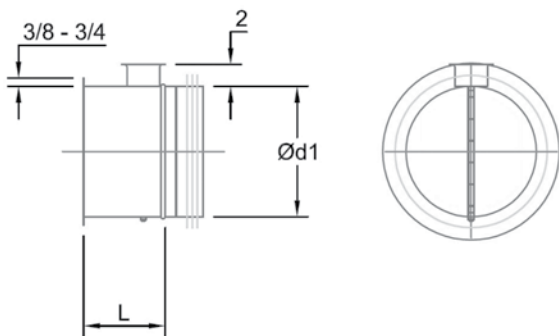

Order Example

Connection	Ød1	Designation	Material	Thickness
G= G3	Diameter	DPT = Take-Off With Damper DPR = Bellmouth Take-Off With Damper	G9	24

G

16

DSIL

G9


24

Smart Part Number: **G16DSILG924**



Description  
damper (DS) with saddle tap (PS) base

- shaft = 5/16" x 5/16"
- 2" shaft extensions available

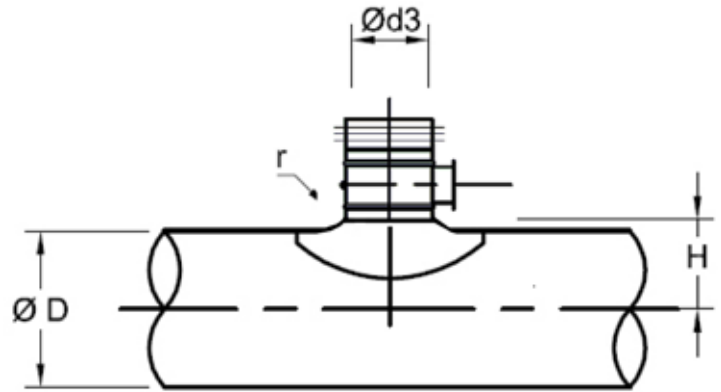

Available in the following sizes (✓):


Available Sizes											
Ød	Ød3										
	3	4	5	6	7	8	9	10	12	14	16
4	✓	✓									
5	✓	✓	✓								
6	✓	✓	✓	✓							
7	✓	✓	✓	✓	✓						
8		✓	✓	✓	✓	✓					
9		✓	✓	✓	✓	✓	✓				
10		✓	✓	✓	✓	✓	✓	✓			
12		✓	✓	✓	✓	✓	✓	✓	✓		
14		✓	✓	✓		✓	✓	✓	✓	✓	
16		✓	✓	✓		✓	✓	✓	✓	✓	✓
18		✓	✓	✓		✓	✓	✓	✓	✓	✓
20		✓	✓	✓		✓	✓	✓	✓	✓	✓
22		✓	✓	✓		✓	✓	✓	✓	✓	✓
24		✓	✓	✓		✓	✓	✓	✓	✓	✓

Order Example

Connection	Ød3	Designation	ØD	Material	Thickness
G= G3	See Chart Above	DSPS = Damper With Saddle Tap	4" - 24"	G9	24

**G**      **8**      **DSPS**      **16**      **G9**      **24**

Smart Part Number: **G8DSPS16G924**

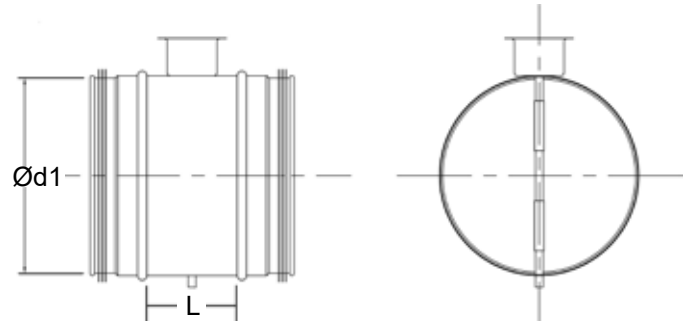

Description

damper with a gasketed blade for complete air-flow shut-off

- gasketed shaft-mounted load bearing bushing to minimize air leakage
- integral shaft-blade assembly
- 2" sheet metal insulation stand-off
- locking blade quadrant w/damper position indicator
- full fitting body assembly with bead stop
- shaft = 5/16" x 5/16"
- damper cup height = 2"
- 2" shaft extension available
- available in stainless steel Ø4"-12"

Note: dampers with Ød1 > 24" have 2" bracket in place of cup-shaped stand-off.

Dimension

Length (L) in inches by diameter:

- 4"-9", L = 3.9"
- 10"-14", L = 3.5"
- 16"-24", L = 3.75"

Order Example


Connection	Ød1	Designation	Material	Thickness
G= G3	Diameter	DT = Balancing Damper	G9	24

**G      Ø4      DT      G9      24**

Smart Part Number: **G04DTG924**

# Square-to-Round


44

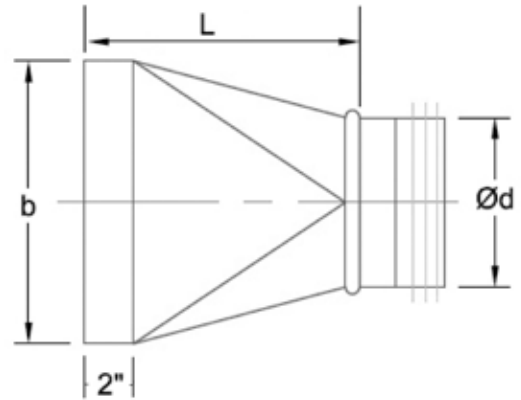

## Description

square to round transition

- available in  $\text{Ø}$  4" - 60"
- 2" raw edge rectangular end
- L = length  
minimum = 12"  
max = 60"
- a = rectangular width
- b = rectangular height
- special order: offset styles available

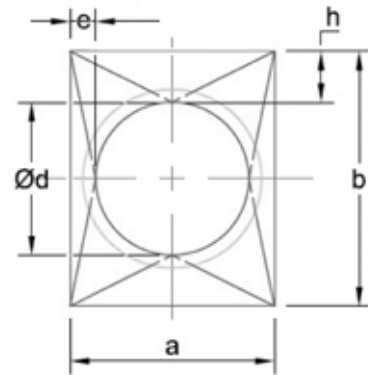

## Order Example

Connection	Ød	Designation	a	b	L	Material	Thickness
G= G3	4" - 60"	RRT = Square To Round	Width	Height	Length	G9	24
<b>G</b>	<b>10</b>	<b>RRT</b>	<b>12</b>	<b>13</b>	<b>14</b>	<b>G9</b>	<b>24</b>

Smart Part Number: **G10RRT121314G924**







EHG  
2600 Airline Boulevard  
Portsmouth, Virginia 23701  
Phone: (866) 757-9414  
[www.EHGduct.com](http://www.EHGduct.com)

REV09.2024

We reserve the right to make changes without prior notice. Therefore, all designs, specifications, and product features are subject to change without notice. The company and its products are protected by registered trademarks.

© Copyright EHG. All rights reserved.